

#### **Features**

- Efficient energy saving supply ventilation in flats, houses, cottages, social and commercial spaces.
- Coarse and fine filters ensure fresh filtered air supply to premises.
- Various operation modes and regulated air exchange create individually controlled microclimate.
- Organization of the air supply system with centralized control based on several ventilation units.



Air flow: up to 50 m³/h 14 l/s



Power: from 3.8 W SFP: from 0.48 W/I/s



Noise level: from 13 dBA






## Design

The ventilator consists of a cartridge with filters, an air duct with sound absorbing material, an indoor unit with a decorative front panel and an outer ventilation hood. The cartridge consists of an energy efficient EC fan and filters that ensure coarse and fine filtration of supply air. The indoor unit is in the basic version equipped with automatic shutters that close during the

ventilator standstill and prevent air backdraft. The outer ventilation hood is used to prevent direct ingress of water and other objects to the ventilator. A remote control, an extended air duct (700 mm) and different external grilles are optionally available for the Fresher 50 units.

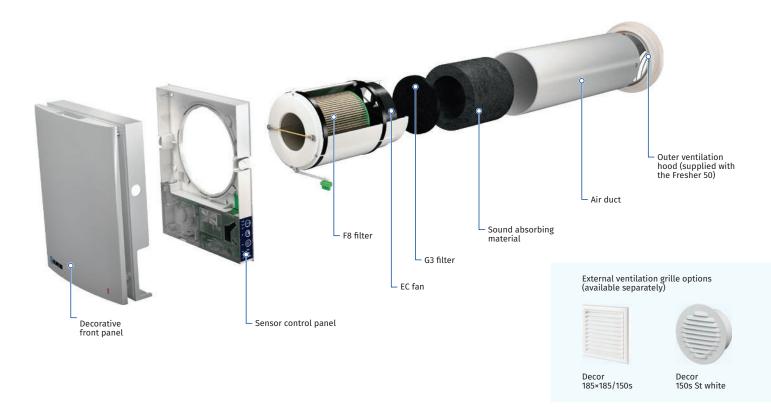



Easy maintenance. The indoor unit can be opened applying a light pressure from both sides



The built-in automatic air shutters prevent back air draft



One of the highest air cleaning efficiency ratings on the market through the use of a modern filter system






The specially designed front panel provides 100 % tightness and wind protection

50




#### Control


The ventilator can be operated with the sensor control panel on the unit casing or with the remote control (FB Fresher 50).



The ventilator design enables connecting any external controls, such as a humidity sensor, an external  $\rm CO_2$  sensor or a switch. Connection of several ventilators in series provides effective, optimal ventilation. The first unit



in series becomes the master unit Ventilation mode is controlled via the control panel on the master unit. The signal from the remote control is received by the first ventilator (master) only.

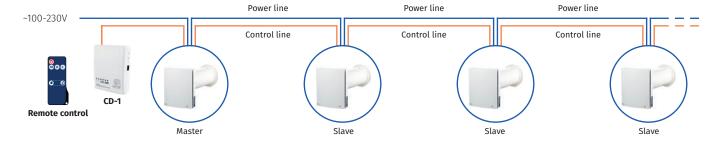


#### Mounting

The unit is designed for through-the-wall mounting into a round hole provided in the outer wall. The unit installation in new-construction buildings is carried out in two phases:

1. Preassembly at the stage of interior and exterior finishing of walls (installing the air duct and the outer ventilation hood, electrical cable laying)


2. Final assembly - before commissioning the house. It includes installation of the cartridge with the fan and filters as well as installation and connection of the indoor unit with the controller and air shutters.

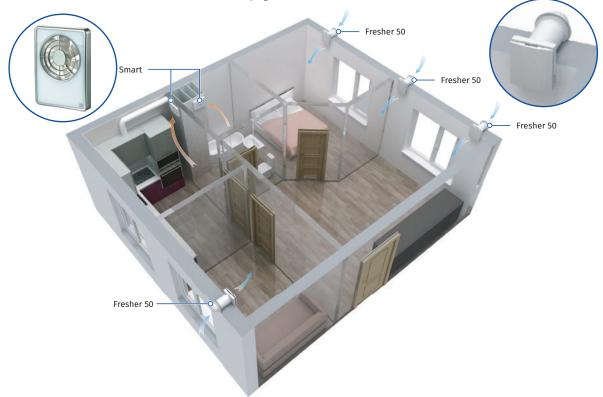


RESIDENTIAL VENTILATION | 2018 51



## Overall dimensions [mm]





Fresher 50 L

# Technical data

| Model                            | Fresher 50 / Fresher 50 L |                 |         |
|----------------------------------|---------------------------|-----------------|---------|
| Speed                            | I                         | II              | III     |
| Voltage [V/50 (60) Hz]           | 1~100-240                 |                 |         |
| Power [W]                        | 3.8                       | 4.7             | 7.4     |
| Current [A]                      | 0.031                     | 0.039           | 0.061   |
| Air flow [m³/h (l/s)]            | 20 (6)                    | 35 (10)         | 50 (14) |
| SFP [W/l/s]                      | 0.68                      | 0.48            | 0.53    |
| Transported air temperature [°C] |                           | from -30 to +50 |         |
| Noise level, 1 m [dBA]           | 22                        | 29              | 32      |
| Noise level, 3 m [dBA]           | 13                        | 20              | 23      |
| Outdoor noise attenuation [dBA]  |                           | 41              |         |
| PM 2.5 removal efficiency [%]    |                           | 98              |         |
| Ingress protection               |                           | IP24            |         |

## Ecodesign parameters

| Trade mark                                   |       | BLAUBERG                            |       |           |       |   |
|--|-------|-------------------------------------|-------|-----------|-------|---|
| Model  |       | Fresher 50                          |       |           |       |   |
| Specific energy consumption (SEC) [kWh(m²a)] | Cold  | Cold Av                             |       | rage Warm |       | m |
|  | -53.2 | A+                                  | -26.1 | В         | -10.6 | Е |
| Type of ventilation unit                     |       | One-directional                     |       |           |       |   |
| Type of drive installed                      |       | Multiple-reduction drive            |       |           |       |   |
| Type of heat recovery system                 |       | No                                  |       |           |       |   |
| Thermal efficiency of heat recovery [%]      |       | n/a                                 |       |           |       |   |
| Maximum air flow [m³/h]                      |       | 50                                  |       |           |       |   |
| Power [W]                                    |       | 7                                   |       |           |       |   |
| Sound power level [dBA]                      |       | 40                                  |       |           |       |   |
| Reference flow rate [m³/s]                   |       | 0.01                                |       |           |       |   |
| Reference pressure difference [Pa]           |       | n/a                                 |       |           |       |   |
| Specific power input (SPI) [W/m³/h]          |       | 0.134                               |       |           |       |   |
| Control typology                             |       | Local demand control                |       |           |       |   |
| Maximum internal leakage rates [%]           |       | n/a                                 |       |           |       |   |
| Maximum external leakage rates [%]           |       | 2.7                                 |       |           |       |   |
| Internet address                             |       | http://www.blaubergventilatoren.de/ |       |           |       |   |
| The annual electricity consumption (AEC)     | Cold  |                                     | Avera | ge        | War   | m |
| [kWh electricity/a]                          | 0.9   |                                     | 0.9   |           | 0.9   | 9 |
| The annual heating saved (AHS)               | Cold  |                                     | Avera | ge        | War   | m |
| [kWh primary energy/a]                       | 55.4  |                                     | 283   |           | 12.   | 8 |

52 blaubergventilatoren.de



| Designation key |                 |                      |   |  |
|-----------------|-----------------|----------------------|---|--|
| Fresher         | 50              | _: 500<br>L: 700     | _: hood by default<br>1: grille Decor 150s St white<br>2: grille Decor 185×185/150s | _: no remote control<br>FB: remote control is included |
| Model           | Air flow [m³/h] | Air duct length [mm] | External grille type  | Option   |

## Accessories

| Accessory name   |                           | Description                                      |
|------------------|---------------------------|--|
| FP Fresher 50 F8 |                           | Filter kit: G3 filter (1 pc) + F8 filter (1 pc)  |
| FB Fresher 50    | <b>0</b> 00<br><b>0</b> 0 | Remote control                                   |
| CD-1             |                           | CO2 sensor with LED indication and on/off button |
| CD-2             |                           | CO <sub>2</sub> sensor                           |
| HR-S             |                           | Room humidistat                                  |
|                  |                           |  |

RESIDENTIAL VENTILATION | 2018 53